
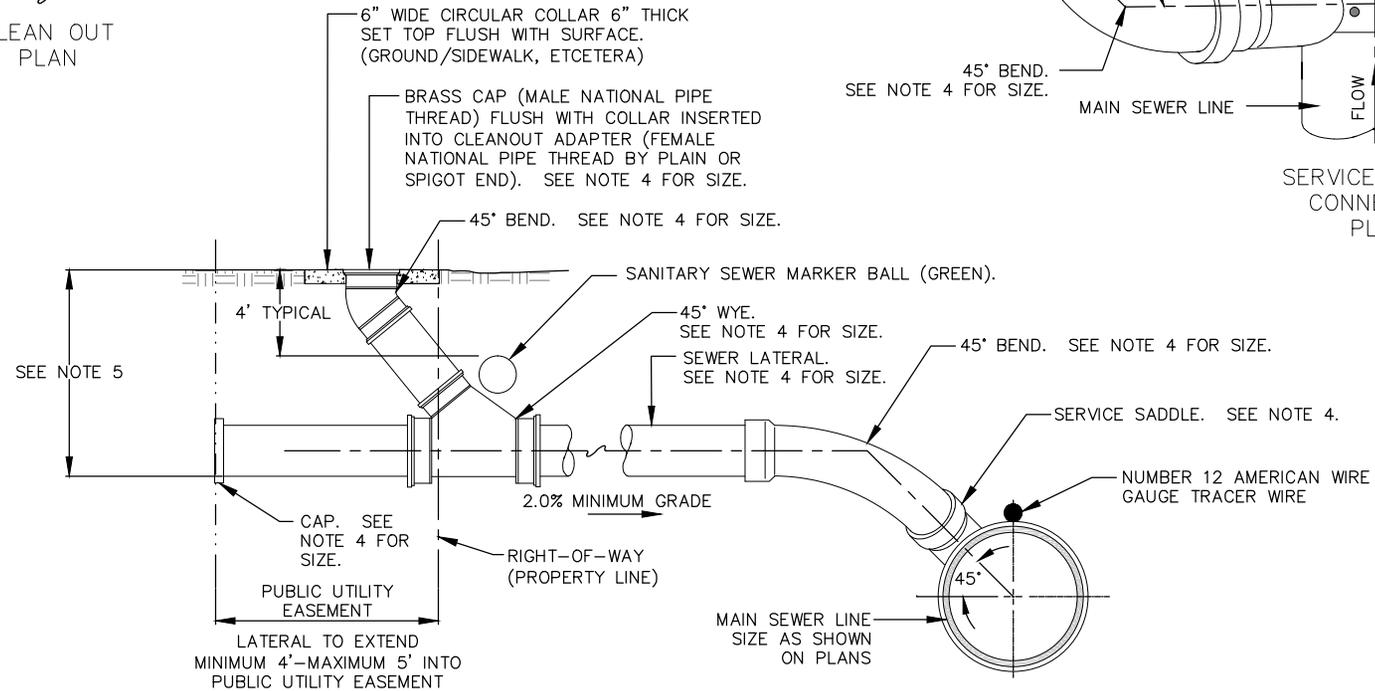


BRASS CAP (MALE NATIONAL PIPE THREAD) FLUSH WITH COLLAR INSERTED INTO CLEANOUT ADAPTER (FEMALE NATIONAL PIPE THREAD BY PLAIN OR SPIGOT END). SEE NOTE 4 FOR SIZE.

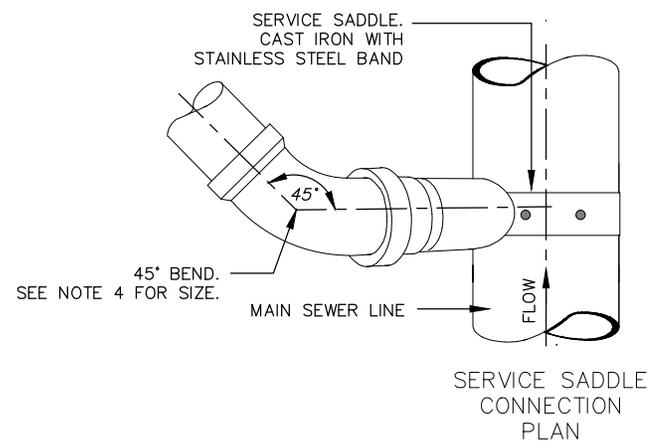


NOTES:

1. CONSTRUCT SEWER LATERAL AT THE STATION OR LOCATION BY DIMENSION AS SHOWN ON PLANS.
2. ALL SEWER LATERALS SHALL HAVE A CLEANOUT.
3. ALL SEWER LATERALS SHALL BE STAMPED WITH AN "S" IN THE GUTTER PAN AND TOP OF CURB DIRECTLY OVER THE LATERAL WHILE CONCRETE IS GREEN.
4. MULTI-FAMILY SERVICES:

<u>NUMBER OF UNITS PER SERVICE</u>	<u>SERVICE SIZE</u>
1 TO 2 DWELLING UNITS	4" SERVICE LINE
3 TO 4 DWELLING UNITS	6" SERVICE LINE
OVER 4 DWELLING UNITS	CONTACT CITY OF RIO RANCHO UTILITIES DEPARTMENT
5. SEWER LATERAL DEPTH AT THE PROPERTY LINE SHALL BE A MAXIMUM OF 7 FEET AND A MINIMUM OF 5 FEET UNLESS OTHERWISE SHOWN ON THE PLANS.
6. REFER TO SECTION 905 OF THE CITY OF RIO RANCHO STANDARD SPECIFICATIONS, AS AMENDED, FOR ADDITIONAL REQUIREMENTS FOR SERVICE SADDLE, SERVICE RISER, AND SERVICE LINE LATERAL MATERIAL REQUIREMENTS TO RIGHT-OF-WAY.

DATE MODIFIED: APRIL 2016



City of Rio Rancho
Department of Public Works

TYPICAL EXISTING SEWER
LATERAL CONNECTION

DWG. NO. S-08 APRIL 22, 2016